
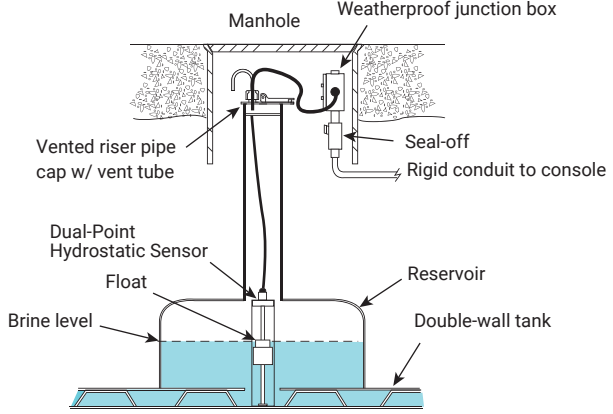


<b>Sensor Description</b>	<b>Dual-Point Hydrostatic Reservoir Sensor (Brine-Filled Double-Wall Tank Sensor)</b>	The Hydrostatic Reservoir Sensor accurately detects fluid level change in the reservoir and interstice of a double wall storage tank. The Dual-Point version is ideal for high groundwater areas, and can differentiate between a high level alarm condition and a low level alarm condition. If an inner-wall leak occurs, the brine seeps into the tank triggering a low level alarm. If an outer wall leak occurs, fluid seeps into the interstice triggering a high level alarm.				
<b>Part Number</b>	<b>794380-303</b>					
<b>Category</b>	<input type="checkbox"/> Discriminating <input type="checkbox"/> Non-Discriminating <input type="checkbox"/> Position Sensitive		<input type="checkbox"/> Level Sensing <input type="checkbox"/> Static Testing <input checked="" type="checkbox"/> Hydrostatic			
<b>Fuel Compatibility</b>	<input checked="" type="checkbox"/> Gas <input checked="" type="checkbox"/> Diesel <input checked="" type="checkbox"/> Kerosene <input checked="" type="checkbox"/> Jet Fuel <input checked="" type="checkbox"/> Aviation Gas		<input checked="" type="checkbox"/> E-15 <input checked="" type="checkbox"/> E-85 <sup>1</sup> <input type="checkbox"/> E-100 <input checked="" type="checkbox"/> Bio-Diesel 20 <input type="checkbox"/> Bio-Diesel 100			<input checked="" type="checkbox"/> Green Diesel <input type="checkbox"/> DEF <input checked="" type="checkbox"/> Waste Oil <input checked="" type="checkbox"/> Motor Oil
<sup>1</sup> Single use only (Test per Sensor Operability Guide in E-10 or less)						
<b>Console Compatibility (*International Only<sup>1</sup>)</b>	<b>Recommended Min. Console Software</b>	<b>Sensor Interface Modules</b>				
		<b>Module Part #</b>	<b>Module Description</b>	<b># of Modules per Console</b>	<b># of Sensor Inputs per Module</b>	
TLS-450PLUS (8600 Series)	6A or Higher	332812-001	Universal Sensor Module (USM)	Up to 4 - TLS-4XX Up to 8 - TLS-4XX w/ opt. TLS-XB	16	
TLS-450	4A or Higher					Sold Separately
TLS4 (8601 Series) <sup>1</sup>	6A or Higher	330020-750	Universal Sensor Input Out-put Module (USIOM-AC)	1	12	
TLS4i (8601 Series)					6	Included
TLS4B (8601 Series) <sup>1</sup>		330020-751	8	Sold Separately		
TLS4c (8601 Series)					124/324 or Higher	329958-001
TLS-350/R/PLUS	329356-003	4 Probe / 4 Sensor Interface Module	1	4		Sold Separately
TLS-350J	330230-001	4 Probe / 8 Sensor Interface Module		8		Included
TLS-300i	330513-001	2 Probe / 8 Sensor Options				
TLS-300C						
<b>Alarm Notification</b>	Normal	Float is in the Center position (correct amount of brine in reservoir)				
	Low Liquid	Brine drops below 1.2" (3cm)		<b>Where Used (Typical)</b>	<input checked="" type="checkbox"/> Annular Space	
	High Liquid	Brine rises above 13.13" (33.4cm)		<input type="checkbox"/> Dispenser Pan	<input type="checkbox"/> STP Sump	
	Sensor Out	Sensor not communicating to ATG/Console		<input type="checkbox"/> Spill Containment	<input checked="" type="checkbox"/> Convault Tank	
					<input type="checkbox"/> Monitoring Well	
					<input type="checkbox"/> Oil/Water Separator Tank	
<b>Specifications</b>	<b>Example Installation</b>					
Operating Principle	Reed Switch /Float					
Product Activation Height	Low 1.2" (3cm), High 13.13" (33.4cm)					
Operating Temp	-13 to +122°F (-25 to +50°C)					
Dimensions	17.3" (43.9cm) High, 2.5" (6.4cm) Dia.					
Miscellaneous/Notes	<ul style="list-style-type: none"> <li>Standard Cable Length: 12ft (3.65m)</li> <li>Vented riser cap assembly included</li> <li>Reservoir solutions: Up to 50% ethylene glycol in water; up to 50% propylene glycol in water; salt brine solution of up to 30% CaCl.</li> </ul>					
Third Party Evaluation Links	<a href="#">TLS-3XX/TLS-450 Series Consoles</a> <a href="#">TLS4 (8601 Series) Consoles</a>					
Product Link	<a href="#">Dual-Point Hydrostatic Reservoir Sensor</a>					
Warranty with System	1 Yr Parts & Labor					
Warranty (When purchased separately)	1 Yr Parts Only					
						

# Notice

---

Veeder-Root makes no warranty of any kind with regard to this publication, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose.

**Veeder-Root shall not be liable for errors contained herein or for incidental or consequential damages in connection with the furnishing, performance, or use of this publication.**

Veeder-Root reserves the right to change system options or features, or the information contained in this publication.

This publication contains proprietary information which is protected by copyright. All rights reserved. No part of this publication may be photocopied, reproduced, or translated to another language without the prior written consent of Veeder-Root.

## **Example Illustrations**

Illustrations used in this guide for example sensor installations may contain components that are customer supplied and not included with the sensor. Please check with your Veeder-Root Distributor for recommended installation accessories.

## **Third Party Evaluations**

Third party evaluations of the Veeder-Root sensors contained in this application guide can be found under the Veeder-Root vendor name on the National Work Group on Leak Detection Evaluations (NWGLDE) website:

<http://www.nwglde.org>